


## Single Foul Water Pump Station with AlertMaxx2

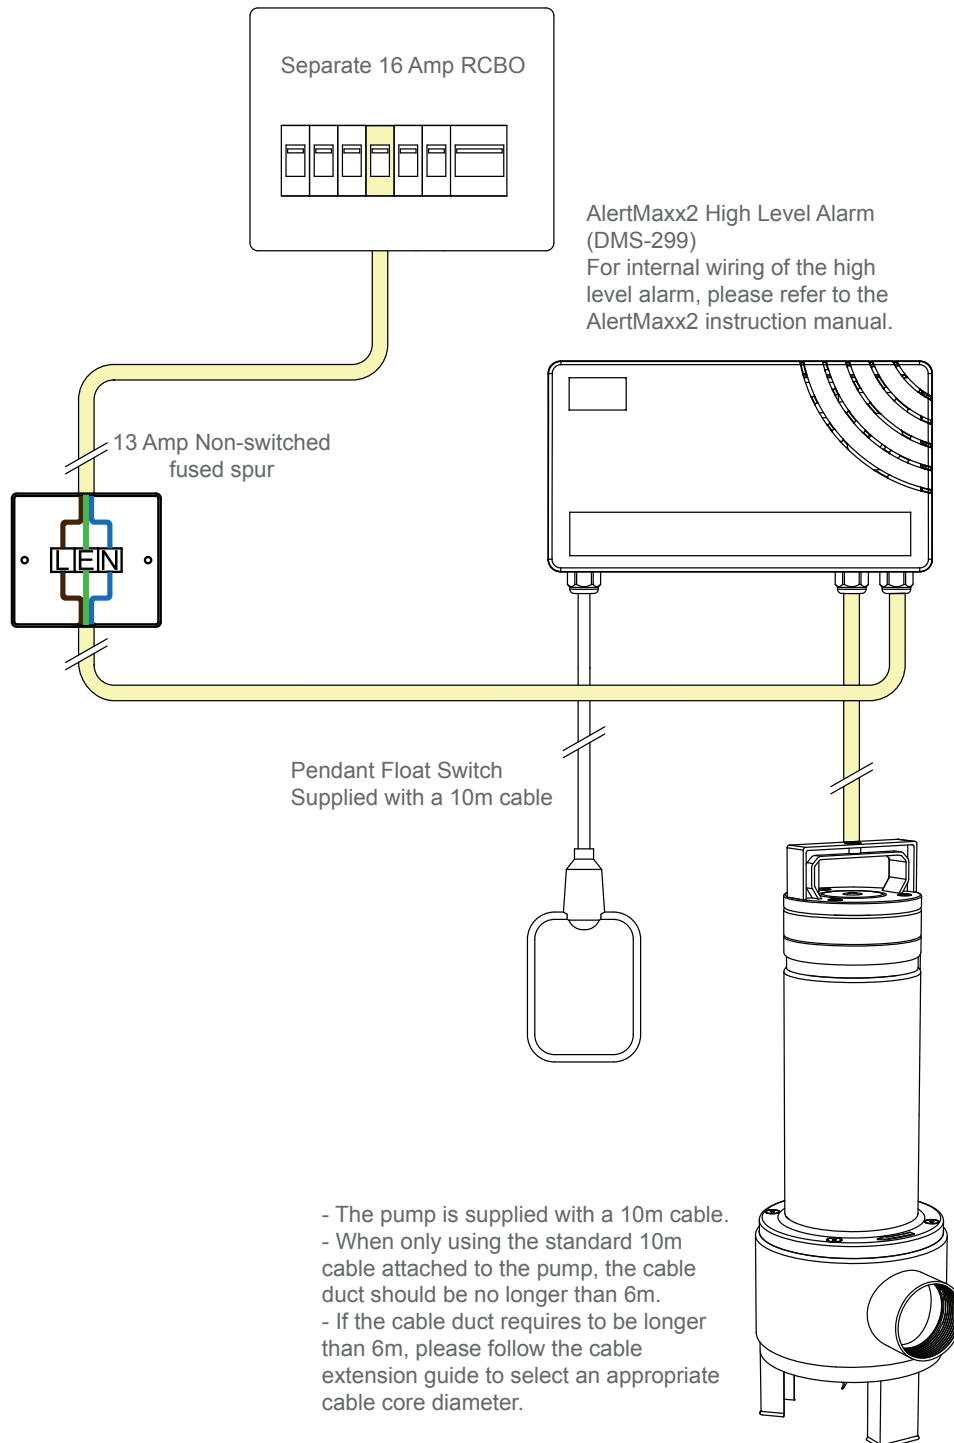

The electrical installation must comply with the requirements of  
**BS 7671:2008 'Requirements for  
Electrical Installations' incorporating amendment 3:2015**