





1=3.83m 2=0.86m 3=3.24m




MUSCULAR STIMULATION

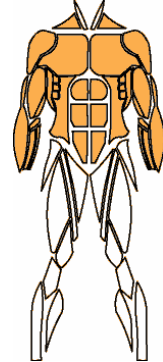


INTENSITY OF EFFORT



ENERGY EXPENDITURE

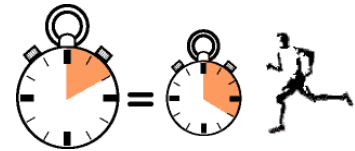


DIMENSIONS & MOVEMENTS

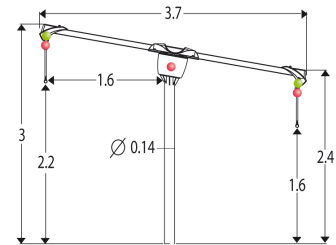


OTHER INFORMATION



2 players



HCL= 0.9m




12+

Installation of equipment



Impact area = minimum safety surfacing required according to EN 1176-1/ EN 1177

———— Impact area

- - - - - Free space

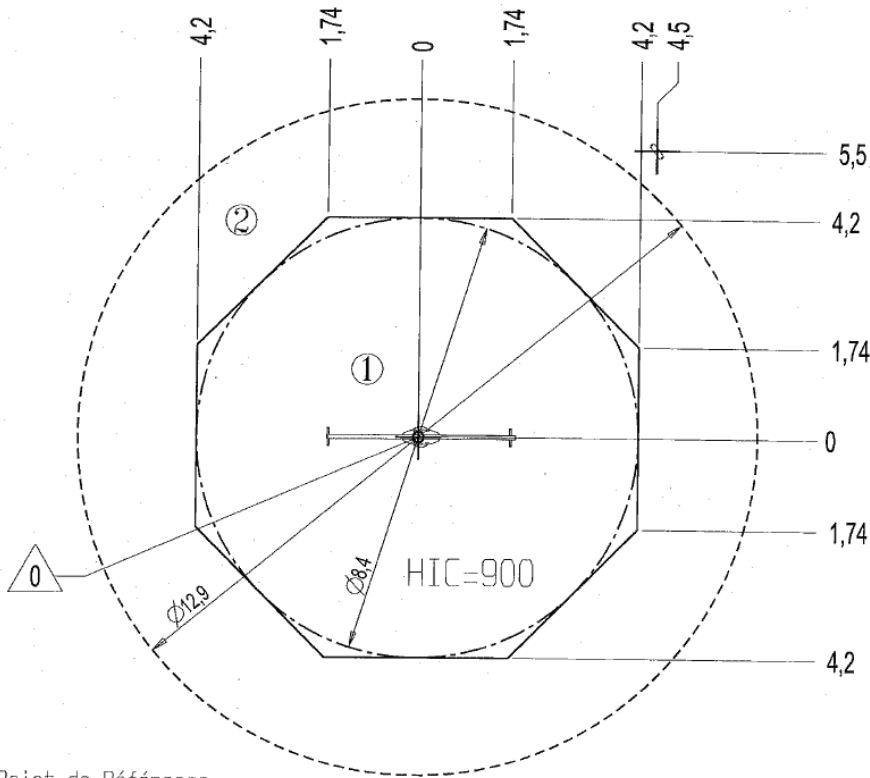

Point de Référence
Setting Out Point
Punto de referencia
Bezugspunkt

	
①	0.9m
②	<0.6m
	55m ²
	76m ²


INSTALLATION



0.6m³



2



03H00

CERTIFICATIONS



V 1 - 2009-11-26